

- ARCHITECTURAL GRADE LAMINATED ASPHALT ROOF SHINGLES ON 3/4" EXTERIOR F.C. PLYWOOD SHEATHING W/ MTL. CLIPS AT UNSUPPORTED JOINTS.
- CONT. MTL. FLASHING
- 24"x4" I.O. METAL STUDS
- 1x HARDIEBOARD FASCIA AND SOFFIT
- EXTERIOR WALL COMPOSITE HARDIEPLANK
- VERTICAL SIDING
- 3/4" EXTERIOR F.C. PLYWOOD
- 6" METAL STUDS AT 16" O.C.

- T.O. CORNICE
- 20"x4" 3/4" I.O. STEEL BEAM LEVEL 4
- STRUCTURAL BEAM - REFER TO STRUCTURAL DWGS
- T.O. FRIEZE
- DRAINABLE EIFS SYSTEM VENEER WITH TEXTURED FINISH
- T.O. ARCHITRAVE

- BRICK VENEER EXTERIOR WALL COMPOSITE
- 4" BRICK VENEER w/ MTL TIES
- AIR SPACE
- 5/8" EXTERIOR FIBER GLASS GYP. BOARD SHEATHING
- METAL STUDS TURNED SIDWAYS

- STRUCTURAL TUBING - REFER TO STRUCTURAL DWGS
- THRUMALL FLASHING w/ KEEPS @ 32" O.C. - TYPICAL
- METAL STD. FRAMING w/ 3/4" EXTERIOR FIBER GLASS GYP. BOARD SHEATHING
- CORNICE
- HORIZ. AND DIAG. 2"x2" STRUCTURAL TUBING - REFER TO STRUCTURAL DWGS
- FRIEZE
- ARCHITRAVE

- BRICK VENEER EXTERIOR WALL COMPOSITE
- 4" BRICK VENEER w/ MTL TIES
- AIR SPACE
- 5/8" EXTERIOR FIBER GLASS GYP. BOARD SHEATHING
- METAL STUDS TURNED SIDWAYS

- THRUMALL FLASHING w/ KEEPS @ 32" O.C. - TYPICAL
- 4" REINF. CONCRETE SIDEWALK
- 0-5/8" I.O. SLAB
- 4" WASHED STONE BASE
- FOOTING - REFER TO STRUCTURAL DWGS

- TAPER INSULATION AWAY FROM FRONT AND SIDE EDGES. TAPER INSULATION TOWARD NORTH EDGE.
- SINGLE PLY MEMBRANE ROOF
- 4" MIN. R-16 (2) LAYERS 2" RIGID INSULATION STAGGER AND TAP JOINTS PER RECOMMENDATIONS.
- T.O. STEEL BEAM - 18"x12"
- 1 1/2" TYPE B METAL ROOF DECK, TYP. - REFER TO STRUCTURAL DWGS
- SUSPENDED CEILING

- EXTERIOR WALL COMPOSITE SYSTEM VENEER (5" RIGID INSUL.)
- TEXTURED FINISH WITH EXP. JOINTS AS SHOWN
- 5/8" EXTERIOR FIBER GLASS GYP. BOARD
- R-21 BATT. INSULATION WITH VAPOR BARRIER
- 6" METAL STUDS AT 16" O.C.
- 3/8" F.C. GYP. BD.

- LEVEL 2 STRUCTURAL TUBING - REFER TO STRUCTURAL DWGS
- TRANSOM WINDOW
- ALUMINUM STOREFRONT

- THRUMALL FLASHING w/ KEEPS @ 32" O.C. - TYPICAL
- 4" REINF. CONCRETE SIDEWALK
- 0-5/8" I.O. SLAB
- 4" WASHED STONE BASE
- FOOTING - REFER TO STRUCTURAL DWGS 4/5/21

- FLOOR FINISH AND BASE (SEE FINISH SCHEDULE)
- 4" CONCRETE SLAB REINF. w/ 6x6 - 14/14 MMF. ON VAPOR BARRIER
- T.O. SLAB
- 3" RIGID PERIMETER INSUL.
- 4" WASHED STONE BASE
- FOOTING - REFER TO STRUCTURAL DWG 4/5/21

- SLOPE AWAY FROM BUILDING

WALL SECTION  
SCALE: 1" = 1'-0"


2  
A5.2

WALL SECTION  
SCALE: 1" = 1'-0"

1  
A5.2

**WALL SECTIONS**

**CLEMMONS FIRST BAPTIST CHURCH NARTHEX ADDITION**

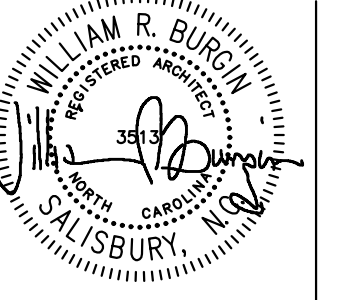

PLC  
DRAWN BY  
HRS  
CHECKED BY  
AUGUST 2017  
DATE  
SITOI  
CONCL. NO.

SHEET NO.  
**A5.2**  
OF 9